


ALICE ITS3 W/P
Pulse measurements
Plotted on 23 Jun 2023
APTS SF
pitch: 15 μm
type: modified with gap
split: 4
 $V_{sub} = V_{pwell} = -0\text{V}$
 $I_{reset} = 100\text{ pA}$
 $I_{biasn} = 5\text{ }\mu\text{A}$
 $I_{biasp} = 0.5\text{ }\mu\text{A}$
 $I_{bias4} = 150\text{ }\mu\text{A}$
 $I_{bias3} = 200\text{ }\mu\text{A}$
 $V_{reset} = 500\text{ mV}$

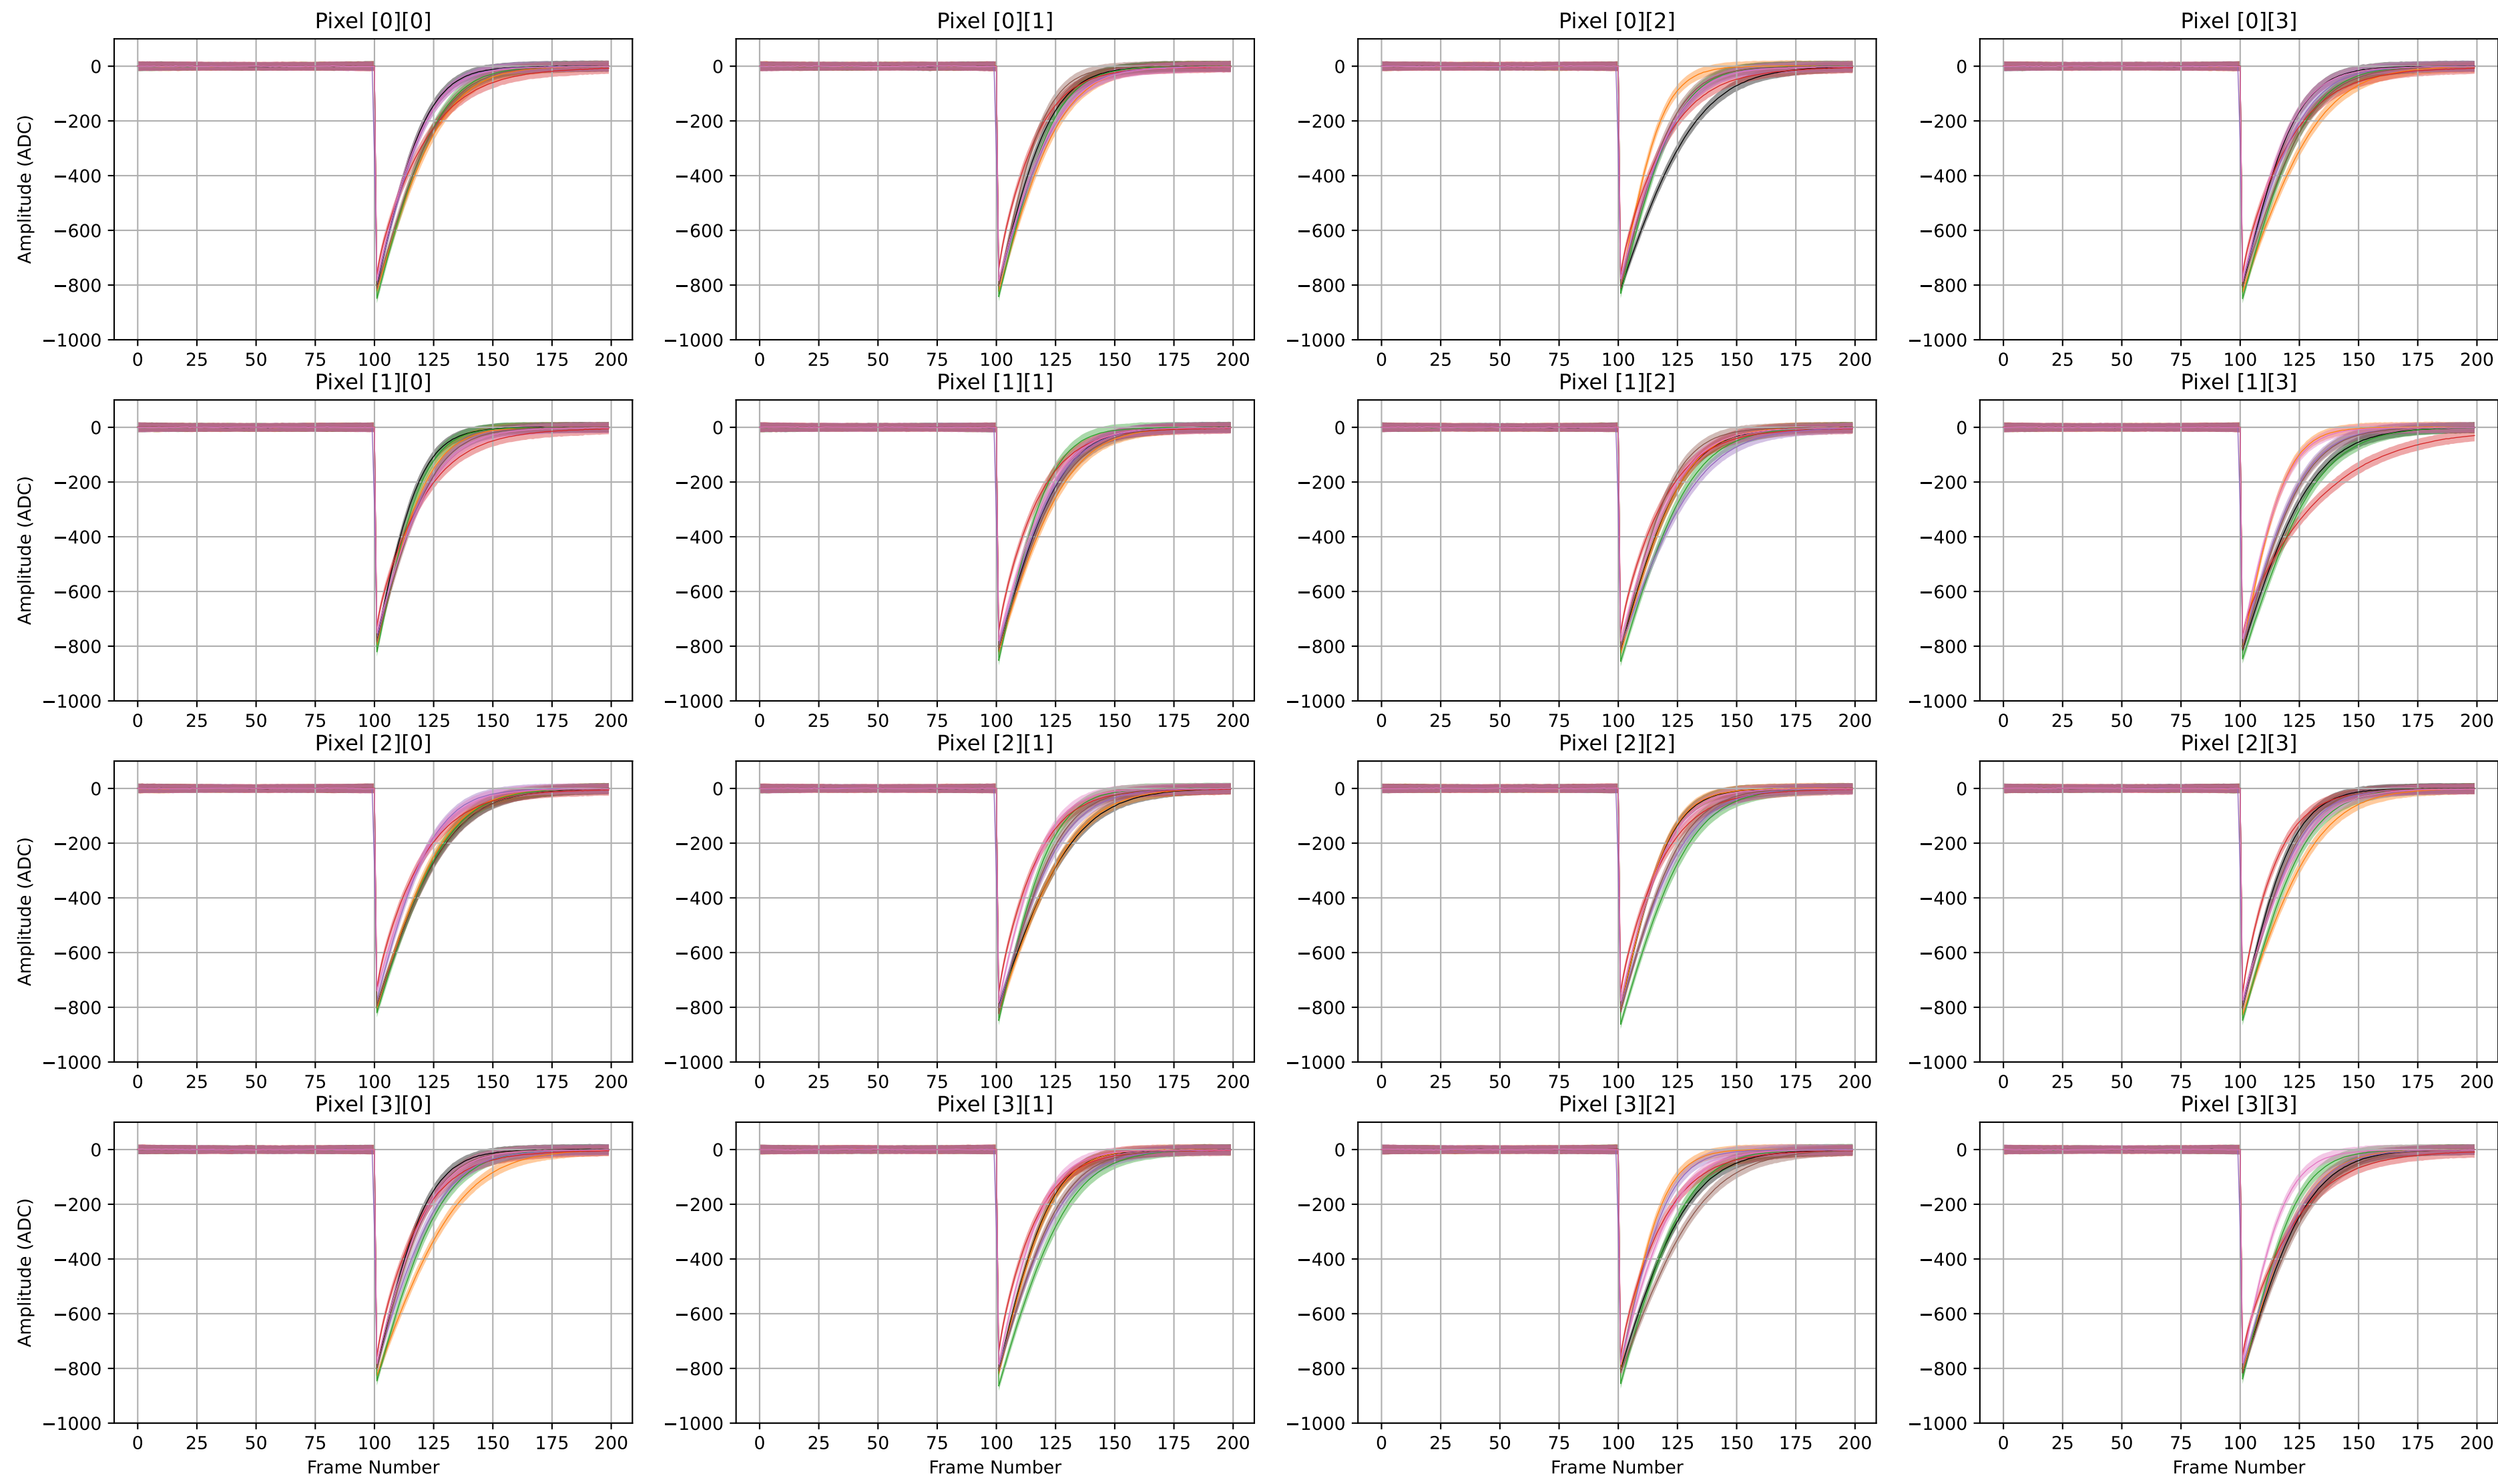

- CERN
- AF15P_W22B22
- Birmingham
- AF15P_W22B3
- Catania
- AF15P_W22B4
- NPI rez
- AF15P_W22B29
- Padova
- AF15P_W22B23
- Pusan
- AF15P_W22B32
- TUM
- AF15P_W22B19